


User Manual for



Ether**CAT**[®] Slave Modules

ECAT-2000 with Digital Inputs and Outputs

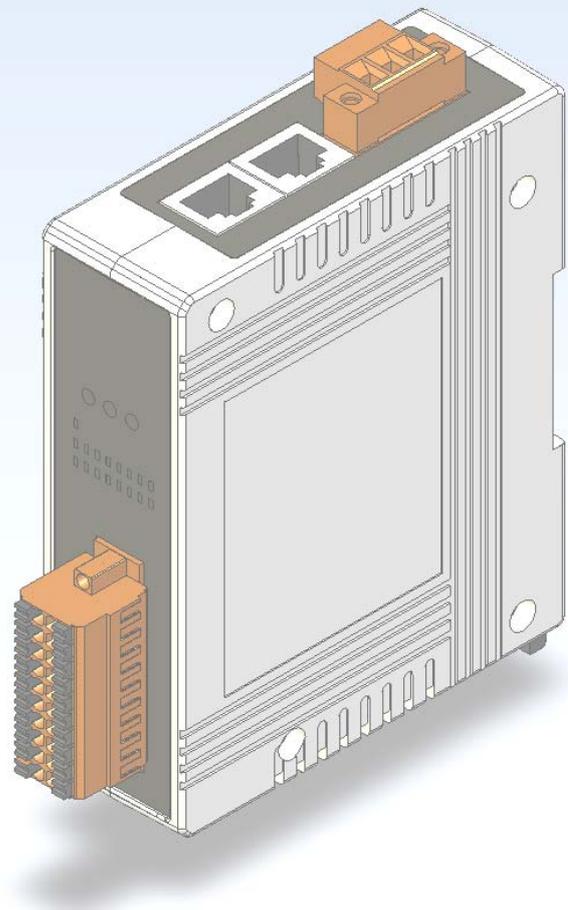

EtherCAT[®] is a registered trademark and patented technology, licensed by Beckhoff Automation GmbH, Germany.

Copyright © 2013 by ICP DAS Co., Ltd. All rights are reserved.

LEGAL NOTICE

Warranty

All products manufactured by ICP DAS are under warranty regarding defective materials for a period of one year, beginning from the date of delivery to the original purchaser.

Warning

ICP DAS assumes no liability for any damage resulting from the use of this product. ICP DAS reserves the right to change this manual at any time without notice. The information furnished by ICP DAS is believed to be accurate and reliable. However, no responsibility is assumed by ICP DAS for its use, nor for any infringements of patents or other rights of third parties resulting from its use.

Copyright

Copyright © 2013 by ICP DAS. All rights are reserved.

Trademarks

Names are used for identification purpose only and may be registered trademarks of their respective companies.

Technology Support


If you have any question for our products, please contact us directly or email to service@icpdas.com.

Shipping Items

The shipping package includes the following items:



ECAT-2000



Quick Start



CD

NOTICE

If any of these items is missing or damaged, please contact your local distributor for more information. Keep the shipping materials and overall package in case you want to ship the module back in the future.

More Information

- Manual:

CD: \fieldbus_cd\ethercat\slave\ecat-2000>manual

http://ftp.icpdas.com/pub/cd/fieldbus_cd/ethercat/slave/ecat-2000/manual/

- ENI:

CD: \fieldbus_cd\ethercat\slave\ecat-2000\software

http://ftp.icpdas.com/pub/cd/fieldbus_cd/ethercat/slave/ecat-2000/software/

- FAQ:

<http://www.icpdas.com/root/support/faq/faq.html>

Table of Contents

| | |
|---|-----------|
| 1 INTRODUCTION | 1 |
| 2 HARDWARE INFORMATION | 2 |
| 2.1 ECAT-2000 GENERAL TECHNICAL DATA | 2 |
| 2.1.1 ETHERCAT INTERFACE | 3 |
| 2.1.2 POWER AND F.G. CONNECTOR | 3 |
| 2.1.3 POWER LED | 3 |
| 2.1.4 STATUS LEDs | 3 |
| 2.1.5 I/O STATUS LEDs | 3 |
| 2.1.6 DIMENSIONS | 4 |
| 2.2 ECAT-2045 | 5 |
| 2.2.1 SPECIFICATIONS | 5 |
| 2.2.2 I/O CONNECTOR (PIN ASSIGNMENT) | 6 |
| 2.2.3 I/O STATUS LEDs | 7 |
| 2.2.4 WIRE CONNECTION | 7 |
| 2.3 ECAT-2051 | 8 |
| 2.3.1 SPECIFICATIONS | 8 |
| 2.3.2 I/O CONNECTOR (PIN ASSIGNMENT) | 9 |
| 2.3.3 I/O STATUS LEDs | 10 |
| 2.3.4 WIRE CONNECTION | 10 |
| 2.4 ECAT-2052 | 11 |
| 2.4.1 SPECIFICATIONS | 11 |
| 2.4.2 I/O CONNECTOR (PIN ASSIGNMENT) | 12 |
| 2.4.3 I/O STATUS LEDs | 13 |
| 2.4.4 WIRE CONNECTION | 13 |
| 2.5 ECAT-2052-NPN | 14 |
| 2.5.1 SPECIFICATIONS | 14 |
| 2.5.2 I/O CONNECTOR (PIN ASSIGNMENT) | 15 |
| 2.5.3 I/O STATUS LEDs | 16 |
| 2.5.4 WIRE CONNECTION | 16 |
| 2.6 ECAT-2053 | 17 |
| 2.6.1 SPECIFICATIONS | 17 |
| 2.6.2 I/O CONNECTOR (PIN ASSIGNMENT) | 18 |
| 2.6.3 I/O STATUS LEDs | 19 |
| 2.6.4 WIRE CONNECTION | 19 |
| 2.7 ECAT-2055 | 20 |
| 2.7.1 SPECIFICATIONS | 20 |
| 2.7.2 I/O CONNECTOR (PIN ASSIGNMENT) | 21 |

| | | |
|-------------|---|-----------|
| 2.7.3 | I/O STATUS LEDs | 22 |
| 2.7.4 | WIRE CONNECTION | 22 |
| 2.8 | ECAT-2057 | 23 |
| 2.8.1 | SPECIFICATIONS | 23 |
| 2.8.2 | I/O CONNECTOR (PIN ASSIGNMENT) | 24 |
| 2.8.3 | I/O STATUS LEDs | 25 |
| 2.8.4 | WIRE CONNECTION | 25 |
| 2.9 | ECAT-2057-NPN | 26 |
| 2.9.1 | SPECIFICATIONS | 26 |
| 2.9.2 | I/O CONNECTOR (PIN ASSIGNMENT) | 27 |
| 2.9.3 | I/O STATUS LEDs | 28 |
| 2.9.4 | WIRE CONNECTION | 28 |
| 2.10 | ECAT-2060 | 29 |
| 2.10.1 | SPECIFICATIONS | 29 |
| 2.10.2 | I/O CONNECTOR (PIN ASSIGNMENT) | 30 |
| 2.10.3 | I/O STATUS LEDs | 31 |
| 2.10.4 | WIRE CONNECTION | 31 |
| 3 | <i>SOFTWARE COMMUNICATIONS</i> | 32 |
| 3.1 | STARTUP | 32 |
| 3.2 | CONFIGURATION | 32 |
| A | <i>GLOSSARY</i> | 37 |
| A.1 | ORDERING INFORMATION | 37 |
| A.2 | TECHNICAL SUPPORT | 37 |

1 Introduction

The ECAT-2000 series are industrial EtherCAT slave remote I/O modules and equipped with the EtherCAT protocol and installed by daisy chain connection which permits the flexibility in devices installation and reduces infrastructure and operation costs. All the modules can be deployed in the network topologies such as star, line or ring. The isolated input and output design protects the ECAT-2000 against the harmful interference and environment.

The ECAT-2000 has passed and verified by the conformance test tool, therefore eligible EtherCAT Master or configurator can manipulate it simply and implement your various applications easily. Fig 1.1 is shown a typical EtherCAT application.

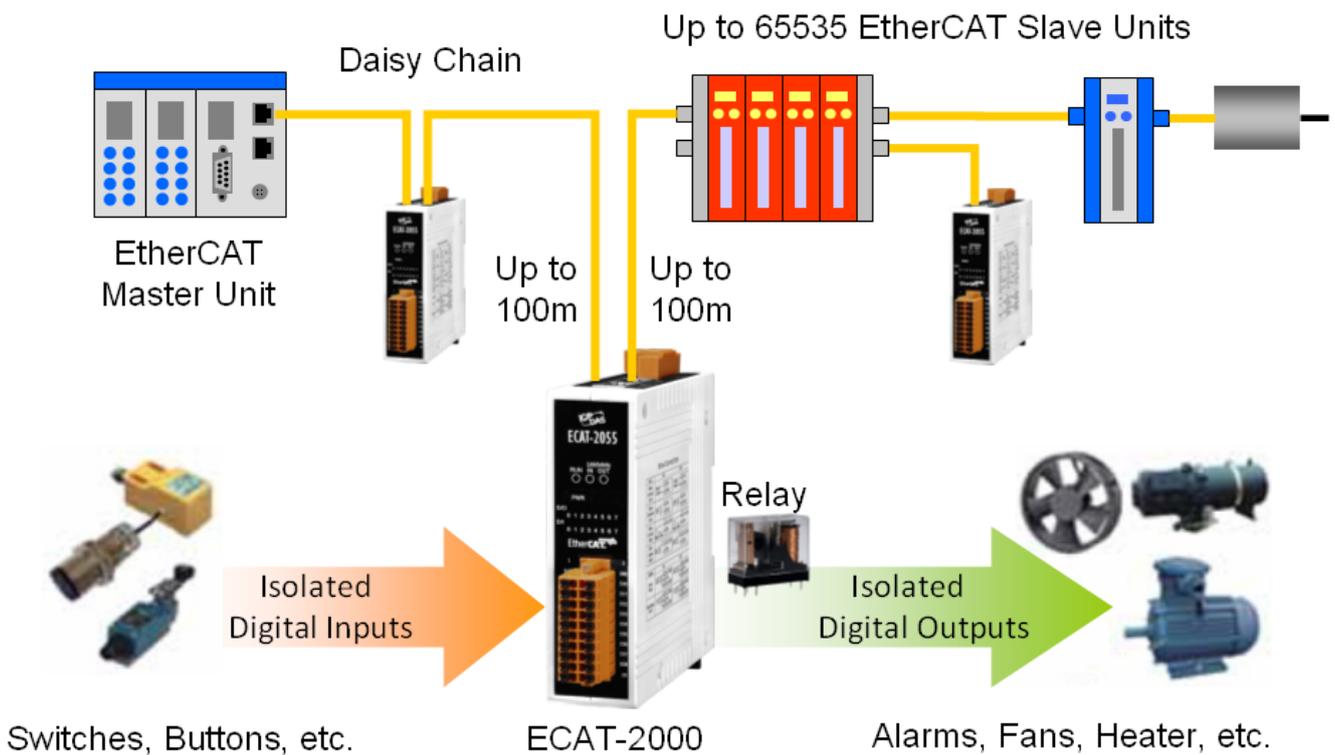


Figure 1.1 Typical Application of ECAT-2000

2 Hardware Information

2.1 ECAT-2000 General Technical Data

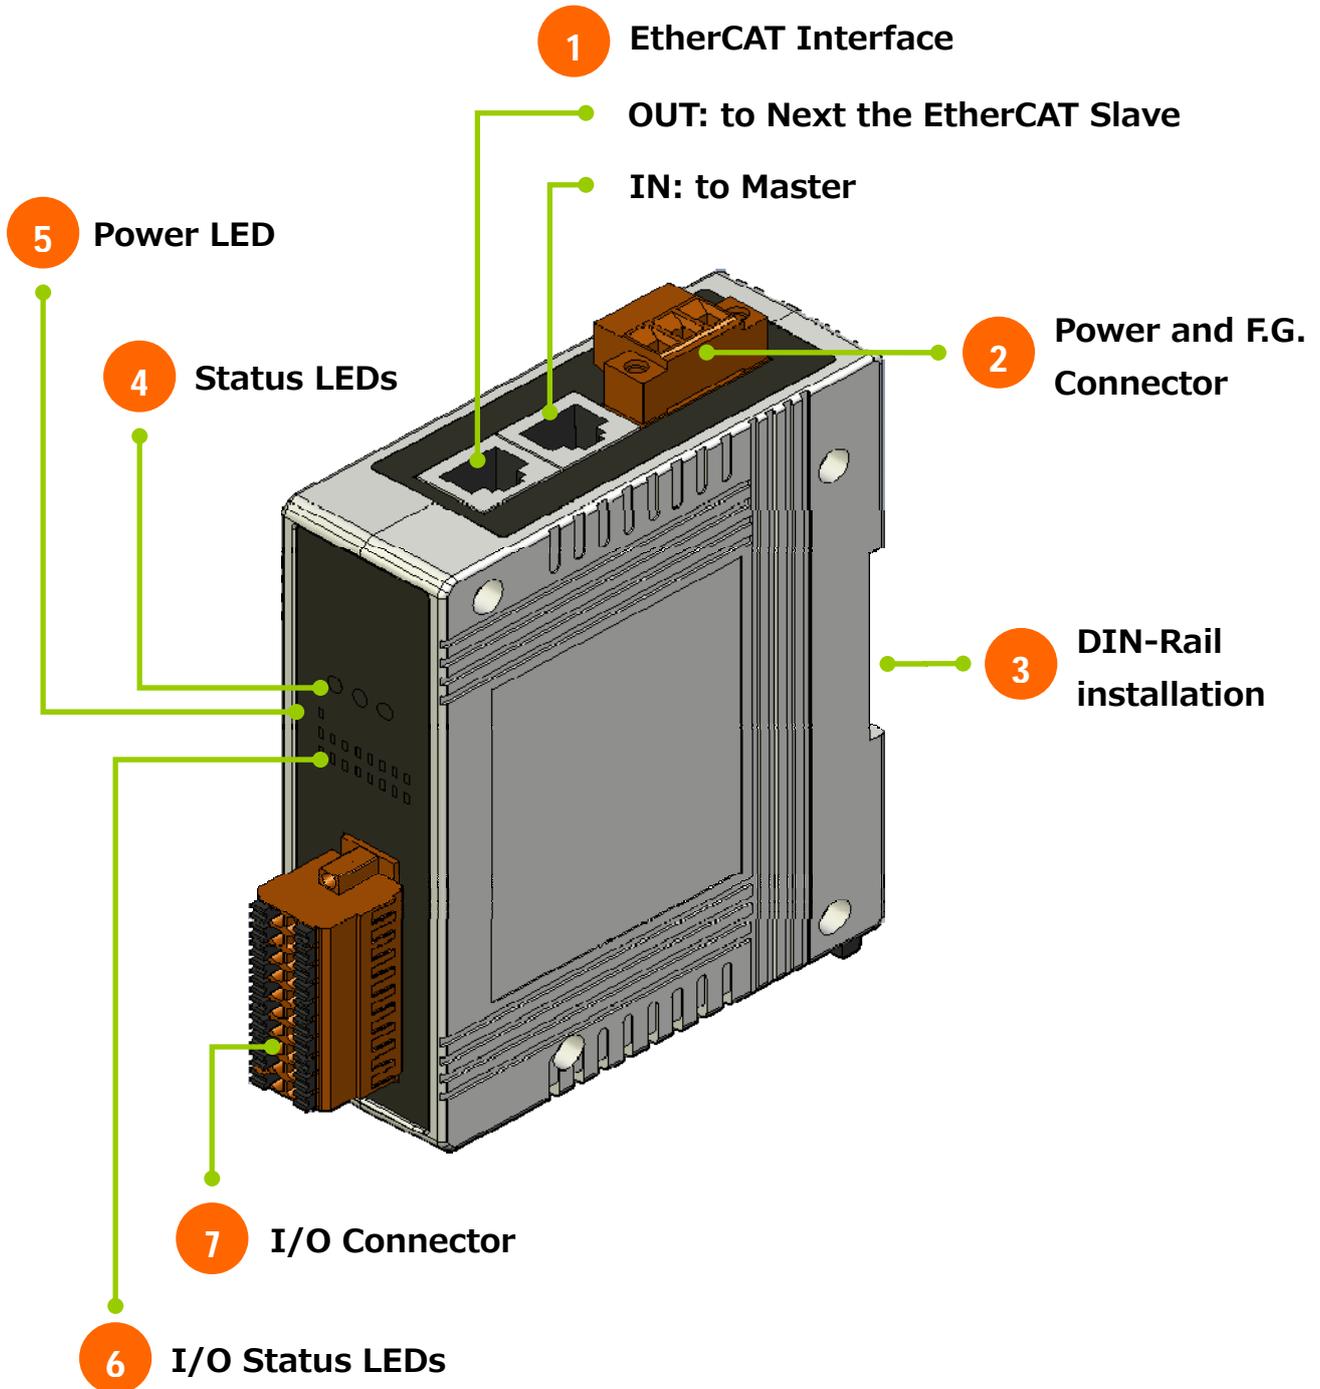


Figure 2.1 Appearance of ECAT-2000

2.1.1 EtherCAT Interface

| Notation | Description |
|----------|--|
| IN | EtherCAT data processing, direction to the EtherCAT master |
| OUT | EtherCAT data processing, direction to the next slave device |



2.1.2 Power and F.G. Connector

| Notation | Description |
|----------|----------------------------------|
| +Vs | Power Supply with +10~+30VDC |
| GND | Power Supply Ground |
| F.G. | Frame Ground; i.e. Earth Contact |

2.1.3 Power LED

| Notation | Color | States | Description |
|----------|-------|--------|--------------------------|
| PWR | RED | On | The device is powered up |




2.1.4 Status LEDs

| Notation | Color | States | Description |
|-------------------------|-------|--------------|---|
| RUN | Green | Off | The device is in state INIT |
| | | Blinking | The device is in state PRE-OPERARIONAL |
| | | Single Flash | The device is in state SAFE-OPERARIONAL |
| | | On | The device is in state OPERARIONAL |
| Link Activity IN/OUT | Green | Off | No link |
| | | Blinking | Link and activity |
| | | On | Link without activity |

2.1.5 I/O Status LEDs

| Notation | Color | States | Description |
|----------|-------|--------|--|
| DI | Green | Off | Input voltage is below the lower switching threshold voltage |
| | | On | Input voltage is higher than the upper switching threshold voltage |
| DO | Green | Off | Digital output status is "Off" |
| | | On | Digital output status is "On" |

2.1.6 Dimensions

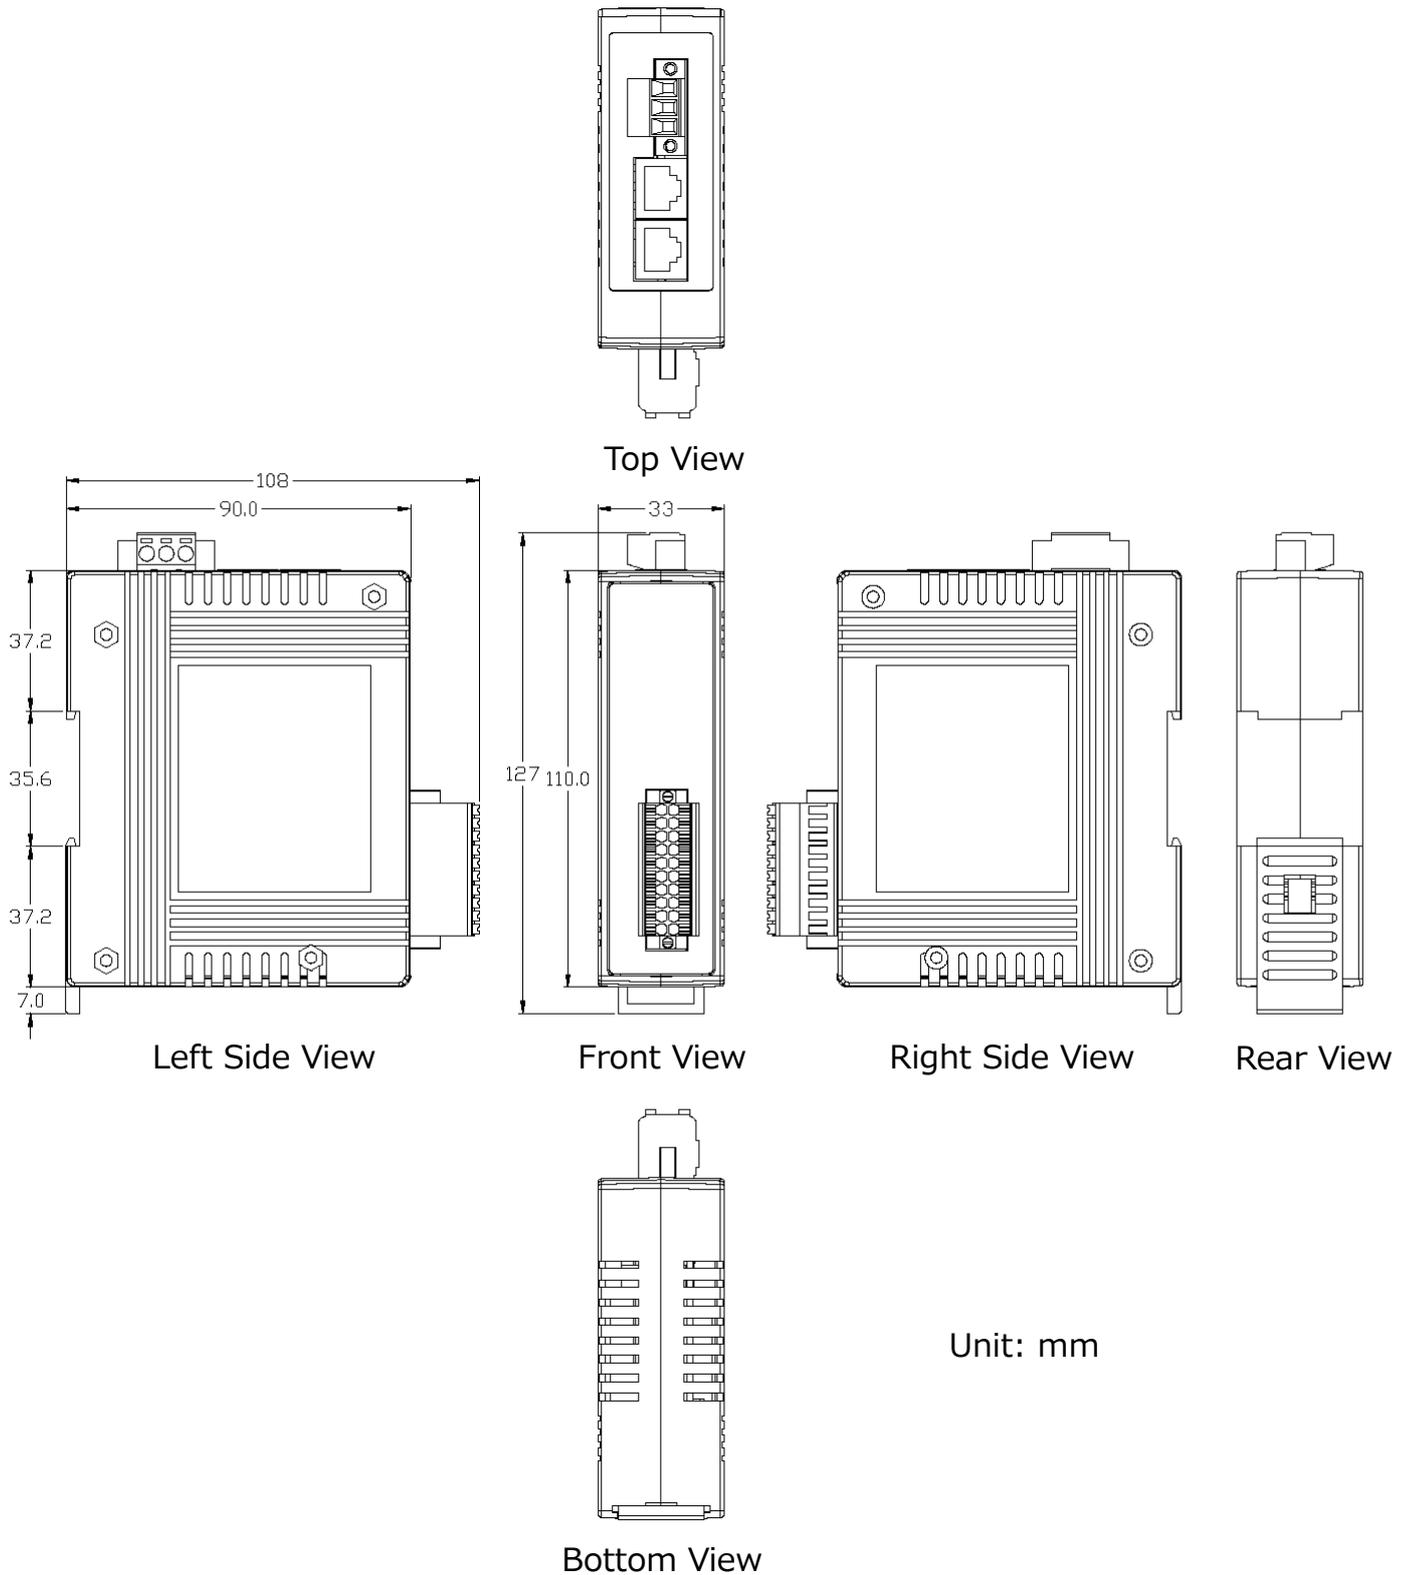

2.2 ECAT-2045




The ECAT-2045 is an industrial EtherCAT slave I/O module which is built in 16 isolated digital outputs. Users can obtain the input and output status not only via the process data but also from its LED indicators.

2.2.1 Specifications


| Digital Output | |
|---------------------------|---|
| Channels | 16 |
| Output Type | Open Collector (Sink) |
| Load Voltage | +3.5 ~ +50 V |
| Max. Load Current | 700mA per Channel |
| Isolation Voltage | 3750 Vrms |
| Power | |
| Input Voltage Range | 10V ~ 30VDC |
| Power Consumption | Max. 4W |
| Communication Interface | |
| Connector | 2 x RJ-45 |
| Protocol | EtherCAT |
| Distance between Stations | Max. 100 m (100BASE-TX) |
| Data Transfer Medium | Ethernet/EtherCAT Cable (Min. CAT 5), Shielded |
| Mechanism | |
| Installation | DIN-Rail |
| Dimensions | 110mm x 90mm x 33mm (H x W x D, without connectors) |
| Case Material | UL 94V-0 Level |

| Environment | |
|-----------------------|---|
| Operating Temperature | -25°C ~ 75°C |
| Storage Temperature | -30°C ~ 80°C |
| Relative Humidity | 10 ~ 90%, No Condensation |
| ESD (IEC 61000-4-2) | 4 KV Contact for Each Channel |
| EFT (IEC 61000-4-4) | Power: 1 KV Class A; Signal: 1 KV Class A |
| Surge (IEC 61000-4-5) | 1 KV Class A |
| Hi-Pot | 1KV Class A |

2.2.2 I/O Connector (Pin Assignment)

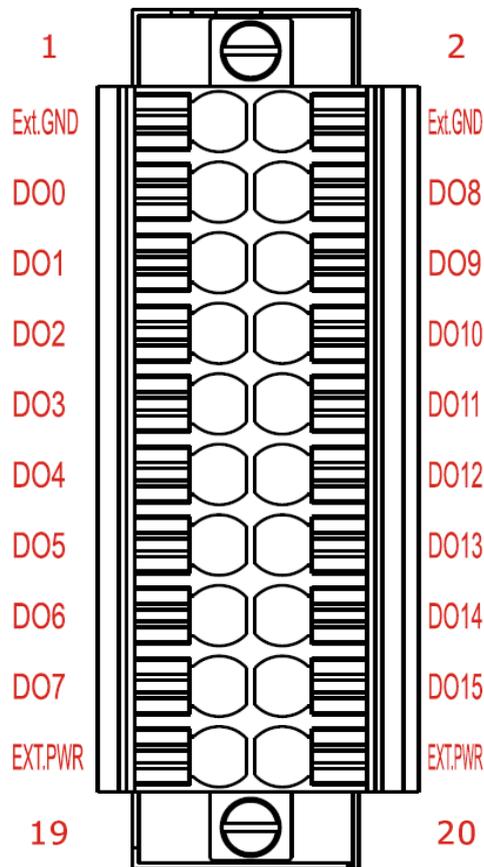


2.2.3 I/O Status LEDs

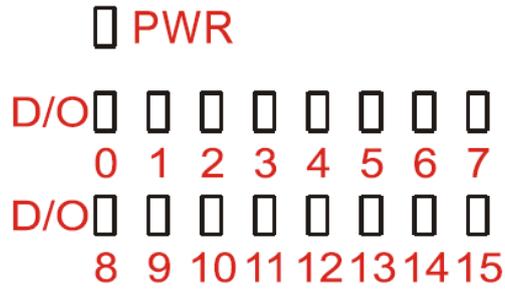

| Notation | Color | States | Description |
|----------|-------|--------|--------------------------------|
| DO | Green | Off | Digital output status is "Off" |
| | | On | Digital output status is "On" |

2.2.4 Wire Connection

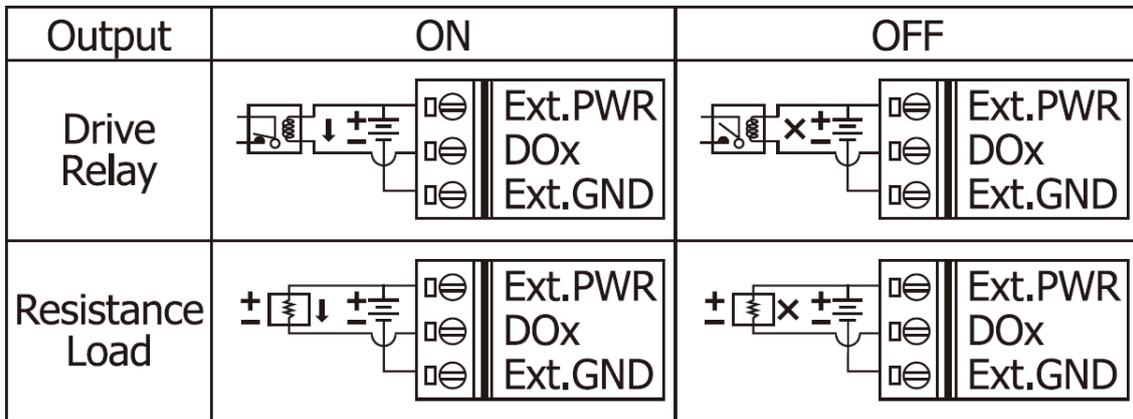

2.3 ECAT-2051




The ECAT-2051 is an industrial EtherCAT slave I/O module which is built in 16 isolated digital inputs. Users can obtain the input and output status not only via the process data but also from its LED indicators.

2.3.1 Specifications


| Digital Input | | |
|---------------------------|---|-------------------|
| Channels | 16 | |
| Input Type | Dry (Source) | Wet (Sink/Source) |
| Off Voltage Level | Open | +4V Max. |
| On Voltage Level | Close to GND | +10 V ~ +50 V |
| Isolation Voltage | 3750 VDC | |
| Power | | |
| Input Voltage Range | 10V ~ 30VDC | |
| Power Consumption | Max. 4W | |
| Communication Interface | | |
| Connector | 2 x RJ-45 | |
| Protocol | EtherCAT | |
| Distance between Stations | Max. 100 m (100BASE-TX) | |
| Data Transfer Medium | Ethernet/EtherCAT Cable (Min. CAT 5), Shielded | |
| Mechanism | | |
| Installation | DIN-Rail | |
| Dimensions | 110mm x 90mm x 33mm (H x W x D, without connectors) | |
| Case Material | UL 94V-0 Level | |

| Environment | |
|-----------------------|---|
| Operating Temperature | -25°C ~ 75°C |
| Storage Temperature | -30°C ~ 80°C |
| Relative Humidity | 10 ~ 90%, No Condensation |
| ESD (IEC 61000-4-2) | 4 KV Contact for Each Channel |
| EFT (IEC 61000-4-4) | Power: 1 KV Class A; Signal: 1 KV Class A |
| Surge (IEC 61000-4-5) | 1 KV Class A |
| Hi-Pot | 1KV Class A |

2.3.2 I/O Connector (Pin Assignment)

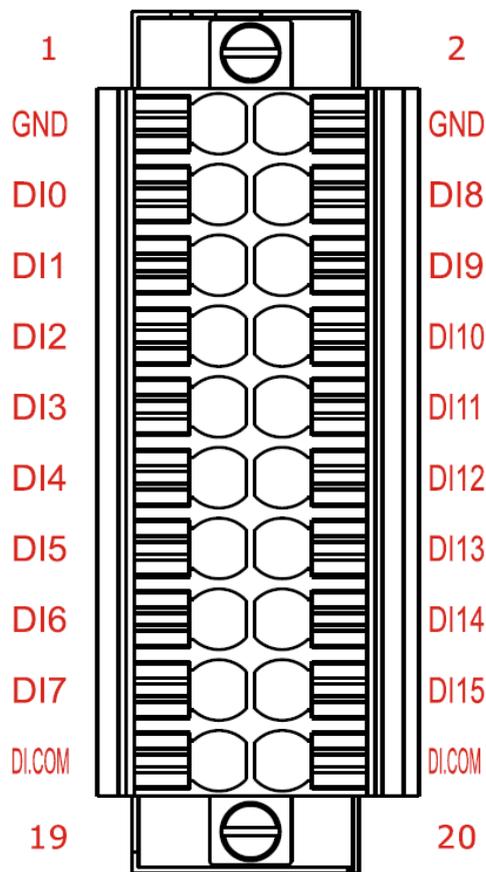

2.3.3 I/O Status LEDs

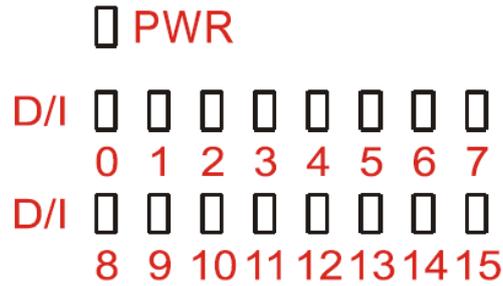

| Notation | Color | States | Description |
|----------|-------|--------|--|
| DI | Green | Off | Input voltage is lower than +4VDC(Max.) |
| | | On | Input voltage is higher than "Off" state |

2.3.4 Wire Connection

| Input | ON | OFF |
|----------------------|----|-----|
| Relay Contact (Dry) | | |
| Open Collector (Dry) | | |
| Relay Contact (Wet) | | |
| NPN Output (Wet) | | |

2.4 ECAT-2052




The ECAT-2052 is an industrial EtherCAT industrial slave I/O module built in 8 isolated digital inputs and 8 isolated digital outputs. Users can obtain the input and output status not only via the process data but also from its LED indicators.

2.4.1 Specifications


| Digital Input | | |
|---------------------------|--|----------------|
| Channels | 8 | |
| Input Type | Wet (Sink/Source) | |
| Off Voltage Level | +2V Max. | |
| On Voltage Level | Close to GND | +3.5 V ~ +50 V |
| Isolation Voltage | 3750 VDC | |
| Digital Output | | |
| Channels | 8 | |
| Output Type | Open Source (Source) | |
| Load Voltage | +3.5 ~ +50 V | |
| Max. Load Current | 100mA per Channel | |
| Isolation Voltage | 3750 Vrms | |
| Communication Interface | | |
| Connector | 2 x RJ-45 | |
| Protocol | EtherCAT | |
| Distance between Stations | Max. 100 m (100BASE-TX) | |
| Data Transfer Medium | Ethernet/EtherCAT Cable (Min. CAT 5), Shielded | |
| Power | | |

| | |
|-----------------------|---|
| Input Voltage Range | 10V ~ 30VDC |
| Power Consumption | Max. 4W |
| Mechanism | |
| Installation | DIN-Rail |
| Dimensions | 110mm x 90mm x 33mm (H x W x D, without connectors) |
| Case Material | UL 94V-0 Level |
| Environment | |
| Operating Temperature | -25°C ~ 75°C |
| Storage Temperature | -30°C ~ 80°C |
| Relative Humidity | 10 ~ 90%, No Condensation |
| ESD (IEC 61000-4-2) | 4 KV Contact for Each Channel |
| EFT (IEC 61000-4-4) | Power: 1 KV Class A; Signal: 1 KV Class A |
| Surge (IEC 61000-4-5) | 1 KV Class A |
| Hi-Pot | 1KV Class A |

2.4.2 I/O Connector (Pin Assignment)

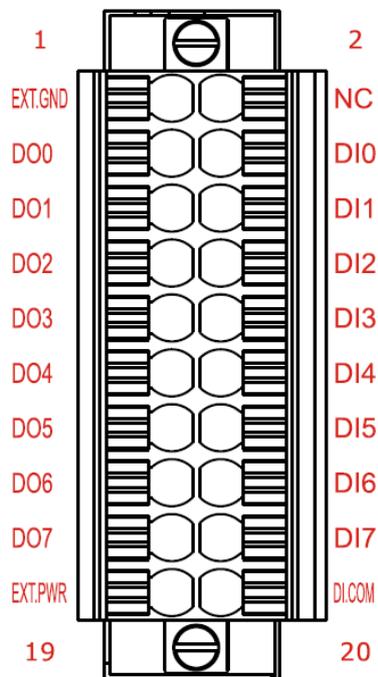


2.4.3 I/O Status LEDs

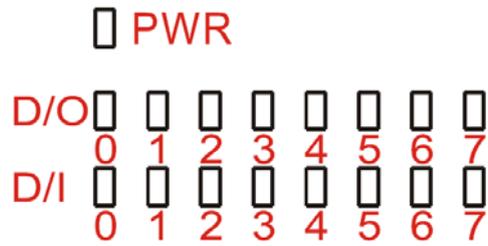

| Notation | Color | States | Description |
|----------|-------|--------|---|
| DI | Green | Off | Input voltage is lower than +3.5VDC(Max.) |
| | | On | Input voltage is higher than "Off" state |
| DO | Green | Off | Digital output status is "Off" |
| | | On | Digital output status is "On" |

2.4.4 Wire Connection

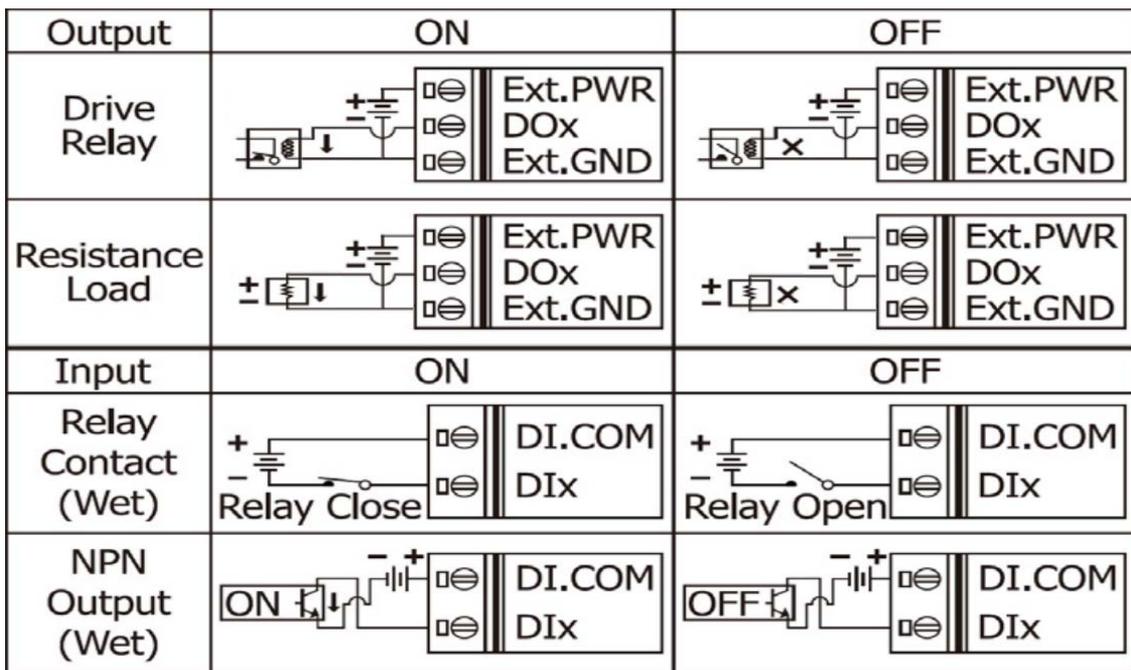

2.5 ECAT-2052-NPN




The ECAT-2052-NPN is an industrial EtherCAT industrial slave I/O module built in 8 isolated digital inputs and 8 isolated digital outputs. Users can obtain the input and output status not only via the process data but also from its LED indicators.

2.5.1 Specifications


| Digital Input | |
|---------------------------|--|
| Channels | 8 |
| Input Type | Wet (Sink/Source) |
| Off Voltage Level | +2V Max. |
| On Voltage Level | +3.5 V ~ +50 V |
| Isolation Voltage | 3750 VDC |
| Digital Output | |
| Channels | 8 |
| Output Type | Open Collector |
| Load Voltage | +3.5 ~ +50 V |
| Max. Load Current | 100mA per Channel |
| Isolation Voltage | 3750 Vrms |
| Communication Interface | |
| Connector | 2 x RJ-45 |
| Protocol | EtherCAT |
| Distance between Stations | Max. 100 m (100BASE-TX) |
| Data Transfer Medium | Ethernet/EtherCAT Cable (Min. CAT 5), Shielded |
| Power | |
| Input Voltage Range | 10V ~ 30VDC |
| Power Consumption | Max. 4W |

| Mechanism | |
|-----------------------|---|
| Installation | DIN-Rail |
| Dimensions | 110mm x 90mm x 33mm (H x W x D, without connectors) |
| Case Material | UL 94V-0 Level |
| Environment | |
| Operating Temperature | -25°C ~ 75°C |
| Storage Temperature | -30°C ~ 80°C |
| Relative Humidity | 10 ~ 90%, No Condensation |
| ESD (IEC 61000-4-2) | 4 KV Contact for Each Channel |
| EFT (IEC 61000-4-4) | Power: 1 KV Class A; Signal: 1 KV Class A |
| Surge (IEC 61000-4-5) | 1 KV Class A |
| Hi-Pot | 1KV Class A |

2.5.2 I/O Connector (Pin Assignment)

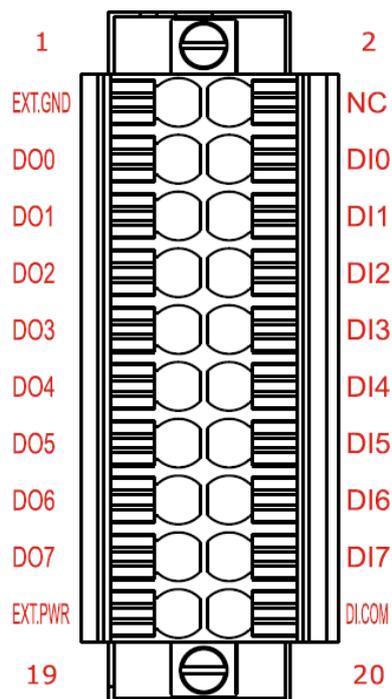

2.5.3 I/O Status LEDs

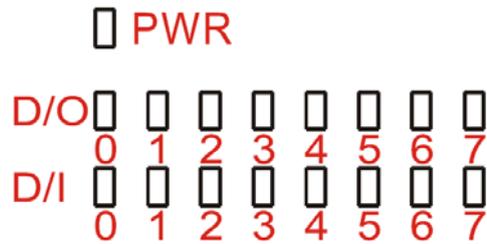


| Notation | Color | States | Description |
|----------|-------|--------|---|
| DI | Green | Off | Input voltage is lower than +3.5VDC(Max.) |
| | | On | Input voltage is higher than "Off" state |
| DO | Green | Off | Digital output status is "Off" |
| | | On | Digital output status is "On" |

2.5.4 Wire Connection

| Input | ON | OFF |
|----------------------|----|-----|
| Relay Contact (Dry) | | |
| Open Collector (Dry) | | |
| Relay Contact (Wet) | | |
| NPN Output (Wet) | | |
| Output | ON | OFF |
| Drive Relay | | |
| Resistance Load | | |

2.6 ECAT-2053

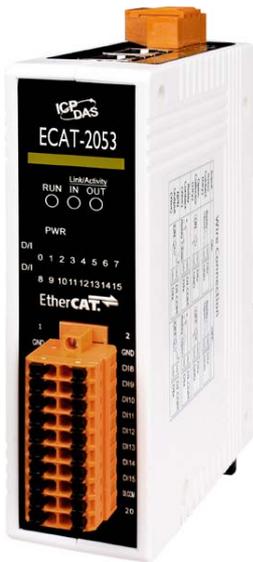


The ECAT-2053 is an industrial EtherCAT slave I/O module which is built in 16 isolated digital inputs. Users can obtain the input and output status not only via the process data but also from its LED indicators.

2.6.1 Specifications


| Digital Input | |
|---------------------------|---|
| Channels | 16 |
| Input Type | Wet (Sink/Source) |
| Off Voltage Level | +2V Max. |
| On Voltage Level | +3.5V ~ +50 V |
| Isolation Voltage | 3750 VDC |
| Power | |
| Input Voltage Range | 10V ~ 30VDC |
| Power Consumption | Max. 4W |
| Communication Interface | |
| Connector | 2 x RJ-45 |
| Protocol | EtherCAT |
| Distance between Stations | Max. 100 m (100BASE-TX) |
| Data Transfer Medium | Ethernet/EtherCAT Cable (Min. CAT 5), Shielded |
| Mechanism | |
| Installation | DIN-Rail |
| Dimensions | 110mm x 90mm x 33mm (H x W x D, without connectors) |
| Case Material | UL 94V-0 Level |
| Environment | |

| | |
|-----------------------|---|
| Operating Temperature | -25°C ~ 75°C |
| Storage Temperature | -30°C ~ 80°C |
| Relative Humidity | 10 ~ 90%, No Condensation |
| ESD (IEC 61000-4-2) | 4 KV Contact for Each Channel |
| EFT (IEC 61000-4-4) | Power: 1 KV Class A; Signal: 1 KV Class A |
| Surge (IEC 61000-4-5) | 1 KV Class A |
| Hi-Pot | 1KV Class A |

2.6.2 I/O Connector (Pin Assignment)

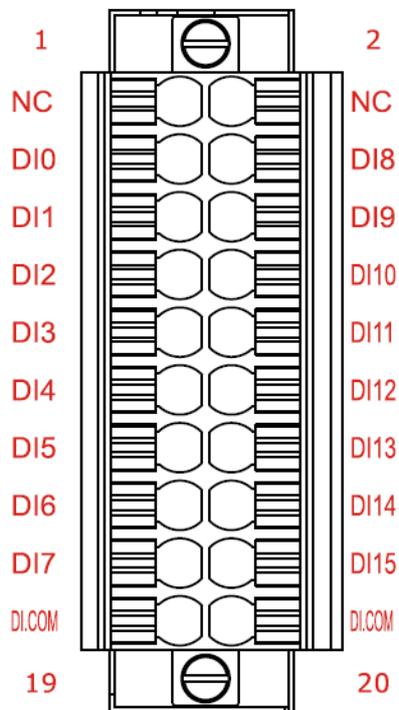


2.6.3 I/O Status LEDs

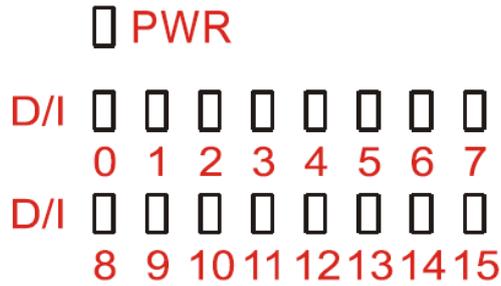

| Notation | Color | States | Description |
|----------|-------|--------|---|
| DI | Green | Off | Input voltage is lower than +3.5VDC(Max.) |
| | | On | Input voltage is higher than "Off" state |

2.6.4 Wire Connection

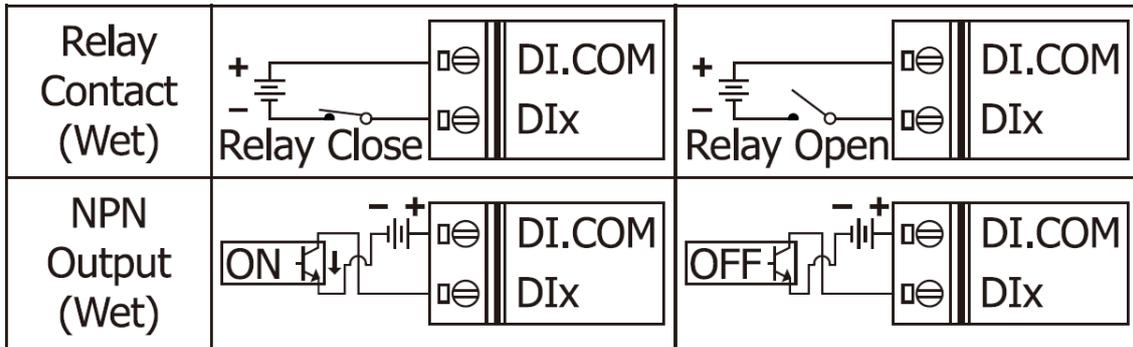

2.7 ECAT-2055




The ECAT-2055 is an industrial slave I/O module built in 8 isolated digital inputs and 8 isolated digital outputs. Users can obtain the input and output status not only via the process data but also from its LED indicators.

2.7.1 Specifications


| Digital Input | | |
|---------------------------|--|-------------------|
| Channels | 8 | |
| Input Type | Dry (Source) | Wet (Sink/Source) |
| Off Voltage Level | Open | +4V Max. |
| On Voltage Level | Close to GND | +10 V ~ +50 V |
| Isolation Voltage | 3750 VDC | |
| Digital Output | | |
| Channels | 8 | |
| Output Type | Open Collector (Sink) | |
| Load Voltage | +3.5 ~ +50 V | |
| Max. Load Current | 700mA per Channel | |
| Isolation Voltage | 3750 Vrms | |
| Communication Interface | | |
| Connector | 2 x RJ-45 | |
| Protocol | EtherCAT | |
| Distance between Stations | Max. 100 m (100BASE-TX) | |
| Data Transfer Medium | Ethernet/EtherCAT Cable (Min. CAT 5), Shielded | |

| Power | |
|-----------------------|---|
| Input Voltage Range | 10V ~ 30VDC |
| Power Consumption | Max. 4W |
| Mechanism | |
| Installation | DIN-Rail |
| Dimensions | 110mm x 90mm x 33mm (H x W x D, without connectors) |
| Case Material | UL 94V-0 Level |
| Environment | |
| Operating Temperature | -25°C ~ 75°C |
| Storage Temperature | -30°C ~ 80°C |
| Relative Humidity | 10 ~ 90%, No Condensation |
| ESD (IEC 61000-4-2) | 4 KV Contact for Each Channel |
| EFT (IEC 61000-4-4) | Power: 1 KV Class A; Signal: 1 KV Class A |
| Surge (IEC 61000-4-5) | 1 KV Class A |
| Hi-Pot | 1KV Class A |

2.7.2 I/O Connector (Pin Assignment)

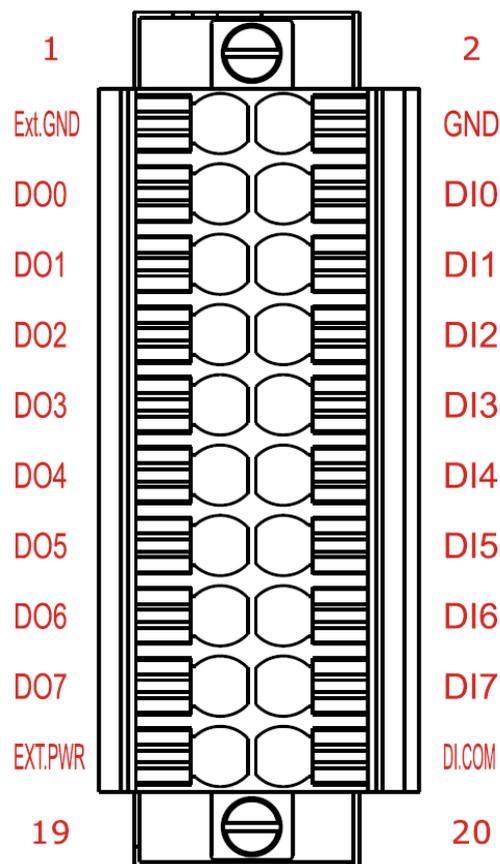

2.7.3 I/O Status LEDs

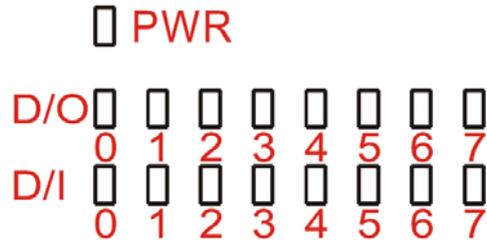

| Notation | Color | States | Description |
|----------|-------|--------|--|
| DI | Green | Off | Input voltage is lower than +4VDC(Max.) |
| | | On | Input voltage is higher than "Off" state |
| DO | Green | Off | Digital output status is "Off" |
| | | On | Digital output status is "On" |

2.7.4 Wire Connection

| Input | ON | OFF |
|----------------------|----|-----|
| Relay Contact (Dry) | | |
| Open Collector (Dry) | | |
| Relay Contact (Wet) | | |
| NPN Output (Wet) | | |
| Output | ON | OFF |
| Drive Relay | | |
| Resistance Load | | |

2.8 ECAT-2057




The ECAT-2057 is an industrial EtherCAT slave I/O module which is built in 16 isolated digital outputs. Users can obtain the input and output status not only via the process data but also from its LED indicators.

2.8.1 Specifications


| Digital Output | |
|---------------------------|---|
| Channels | 16 |
| Output Type | Open Source (Source) |
| Load Voltage | +3.5 ~ +30 V |
| Max. Load Current | 100mA per Channel |
| Isolation Voltage | 3750 Vrms |
| Power | |
| Input Voltage Range | 10V ~ 30VDC |
| Power Consumption | Max. 4W |
| Communication Interface | |
| Connector | 2 x RJ-45 |
| Protocol | EtherCAT |
| Distance between Stations | Max. 100 m (100BASE-TX) |
| Data Transfer Medium | Ethernet/EtherCAT Cable (Min. CAT 5), Shielded |
| Mechanism | |
| Installation | DIN-Rail |
| Dimensions | 110mm x 90mm x 33mm (H x W x D, without connectors) |
| Case Material | UL 94V-0 Level |

| Environment | |
|-----------------------|---|
| Operating Temperature | -25°C ~ 75°C |
| Storage Temperature | -30°C ~ 80°C |
| Relative Humidity | 10 ~ 90%, No Condensation |
| ESD (IEC 61000-4-2) | 4 KV Contact for Each Channel |
| EFT (IEC 61000-4-4) | Power: 1 KV Class A; Signal: 1 KV Class A |
| Surge (IEC 61000-4-5) | 1 KV Class A |
| Hi-Pot | 1KV Class A |

2.8.2 I/O Connector (Pin Assignment)

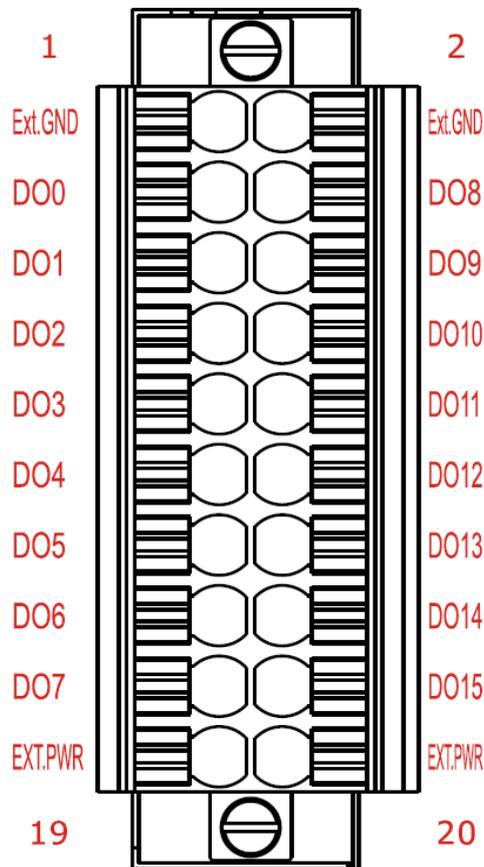


2.8.3 I/O Status LEDs

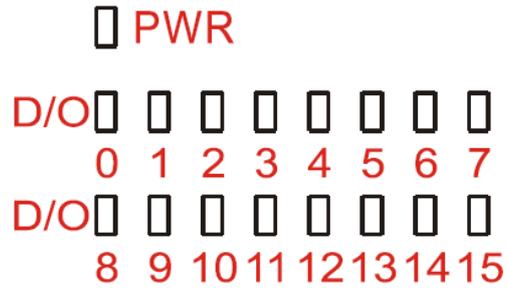

| Notation | Color | States | Description |
|----------|-------|--------|--------------------------------|
| DO | Green | Off | Digital output status is "Off" |
| | | On | Digital output status is "On" |

2.8.4 Wire Connection

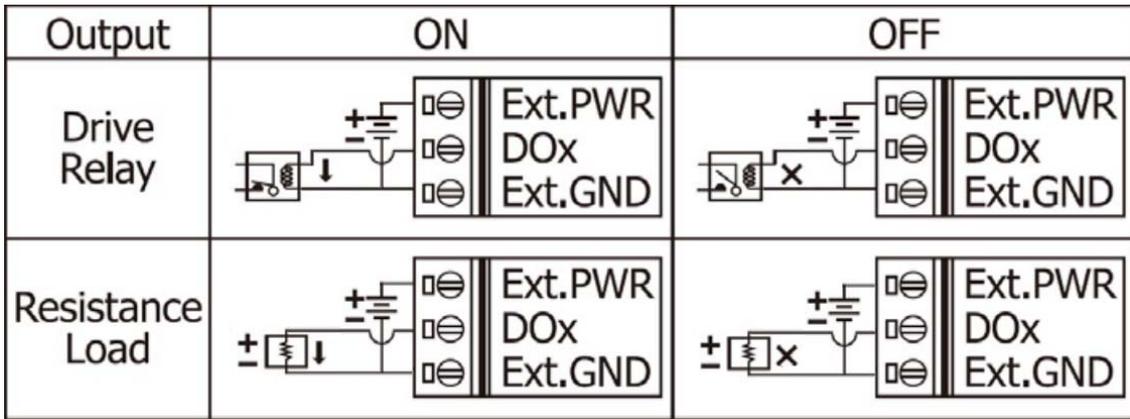

2.9 ECAT-2057-NPN




The ECAT-2057-NPN is an industrial EtherCAT slave I/O module which is built in 16 isolated digital outputs. Users can obtain the input and output status not only via the process data but also from its LED indicators.

2.9.1 Specifications


| Digital Output | |
|---------------------------|---|
| Channels | 16 |
| Output Type | Open Collector (Sink) |
| Load Voltage | +3.5 ~ +30 V |
| Max. Load Current | 100mA per Channel |
| Isolation Voltage | 3750 Vrms |
| Power | |
| Input Voltage Range | 10V ~ 30VDC |
| Power Consumption | Max. 4W |
| Communication Interface | |
| Connector | 2 x RJ-45 |
| Protocol | EtherCAT |
| Distance between Stations | Max. 100 m (100BASE-TX) |
| Data Transfer Medium | Ethernet/EtherCAT Cable (Min. CAT 5), Shielded |
| Mechanism | |
| Installation | DIN-Rail |
| Dimensions | 110mm x 90mm x 33mm (H x W x D, without connectors) |
| Case Material | UL 94V-0 Level |

| Environment | |
|-----------------------|---|
| Operating Temperature | -25°C ~ 75°C |
| Storage Temperature | -30°C ~ 80°C |
| Relative Humidity | 10 ~ 90%, No Condensation |
| ESD (IEC 61000-4-2) | 4 KV Contact for Each Channel |
| EFT (IEC 61000-4-4) | Power: 1 KV Class A; Signal: 1 KV Class A |
| Surge (IEC 61000-4-5) | 1 KV Class A |
| Hi-Pot | 1KV Class A |

2.9.2 I/O Connector (Pin Assignment)

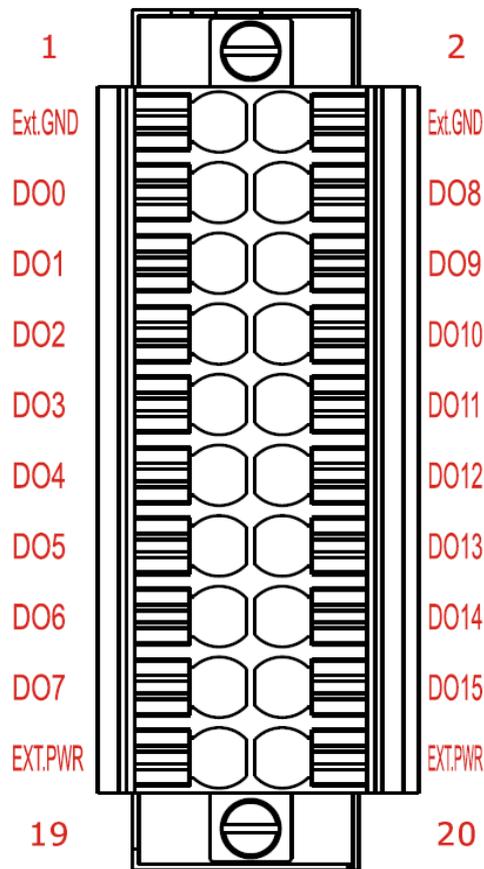


2.9.3 I/O Status LEDs

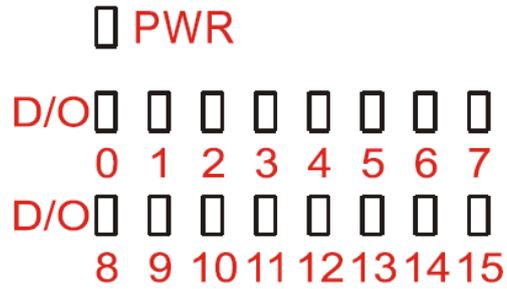

| Notation | Color | States | Description |
|----------|-------|--------|--------------------------------|
| DO | Green | Off | Digital output status is "Off" |
| | | On | Digital output status is "On" |

2.9.4 Wire Connection

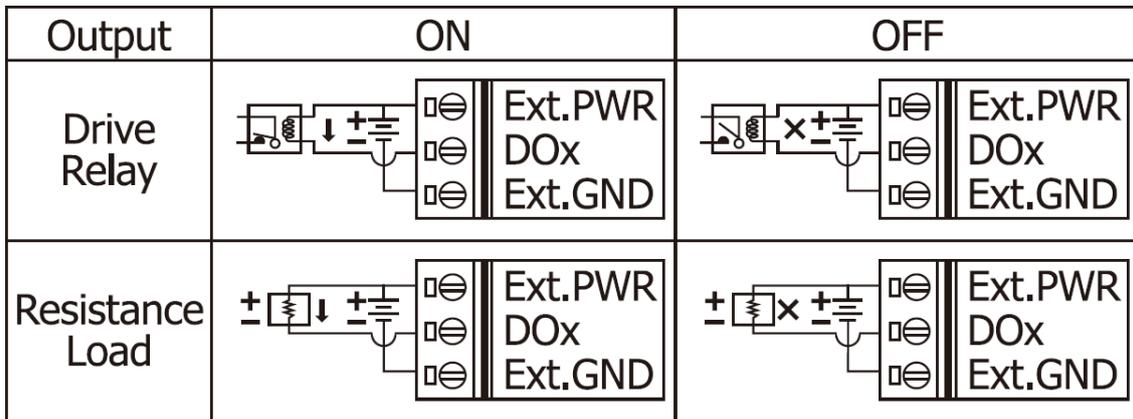

2.10 ECAT-2060




The ECAT-2060 is an industrial slave I/O module built in 6 isolated digital inputs and 6 isolated relay outputs. Users can obtain the input and output status not only via the process data but also from its LED indicators.

2.10.1 Specifications

| Digital Input | | |
|---------------------------------|----------------------------------|-------------------|
| Channels | 6 | |
| Input Type | Dry (Source) | Wet (Sink/Source) |
| Off Voltage Level | Open | +4V Max. |
| On Voltage Level | Close to GND | +10 V ~ +50 V |
| Isolation Voltage | 3750 VDC | |
| Digital Output | | |
| Channels | 6 | |
| Output Type | Form A (SPST-NO) | |
| Contact Rating (Resistive Load) | 5A@30VDC; 5A@125/250VAC(47~63Hz) | |
| Operate Time | 10 ms Max. | |
| Release Time | 5 ms Max. | |
| Mechanical Endurance | 2 x 10 ⁷ Ops. | |
| Electrical Endurance | 10 ⁵ Ops. | |
| Power | | |
| Input Voltage Range | 10V ~ 30VDC | |
| Power Consumption | Max. 4W | |

| Communication Interface | |
|---------------------------|---|
| Connector | 2 x RJ-45 |
| Protocol | EtherCAT |
| Distance between Stations | Max. 100 m (100BASE-TX) |
| Data Transfer Medium | Ethernet/EtherCAT Cable (Min. CAT 5), Shielded |
| Mechanism | |
| Installation | DIN-Rail |
| Dimensions | 110mm x 90mm x 33mm (H x W x D, without connectors) |
| Case Material | UL 94V-0 Level |
| Environment | |
| Operating Temperature | -25°C ~ 75°C |
| Storage Temperature | -30°C ~ 80°C |
| Relative Humidity | 10 ~ 90%, No Condensation |
| ESD (IEC 61000-4-2) | 4 KV Contact for Each Channel |
| EFT (IEC 61000-4-4) | Power: 1 KV Class A; Signal: 1 KV Class A |
| Surge (IEC 61000-4-5) | 1 KV Class A |
| Hi-Pot | 1KV Class A |

2.10.2 I/O Connector (Pin Assignment)

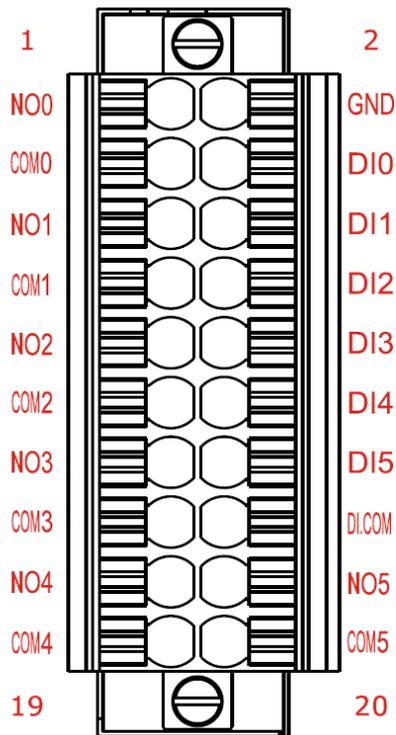

2.10.3 I/O Status LEDs

□ PWR

D/O □ □ □ □ □ □
 0 1 2 3 4 5
 D/I □ □ □ □ □ □
 0 1 2 3 4 5

| Notation | Color | States | Description |
|----------|-------|--------|--|
| DI | Green | Off | Input voltage is lower than +4VDC(Max.) |
| | | On | Input voltage is higher than "Off" state |
| DO | Green | Off | Digital output status is "Off" |
| | | On | Digital output status is "On" |

2.10.4 Wire Connection

| Input | ON | OFF |
|----------------------|----|-----|
| Relay Contact (Dry) | | |
| Open Collector (Dry) | | |
| Relay Contact (Wet) | | |
| NPN Output (Wet) | | |
| Output | ON | OFF |
| Relay | | |

3 *Software Communications*

3.1 Startup

EtherCAT devices are described in an XML file, ESI (EtherCAT Slave Information) file, which describes the modules of the ECAT-2000 series named "*ICPDAS ECAT-2000.xml*."


1. Download the ESI file, *ICPDAS ECAT-2000.xml*, from the website http://ftp.icpdas.com/pub/cd/fieldbus_cd/ethercat/slave/ecat-2000/software/ or from the CD in the shipping package
CD: \fieldbus_cd\ethercat\slave\ecat-2000\software
2. Copy the file "*ICPDAS ECAT-2000.xml*" to the destination folder of EtherCAT Master Tools(*Beckhoff EtherCAT Configurator* or *TwinCAT* etc.)
C:\EtherCAT Configurator\EtherCAT\ICPDAS ECAT-2000.xml
C:\TwinCAT\Io\EtherCAT\ICPDAS ECAT-2000.xml
Otherwise, if you are using another tool, to the folder set for that tool.

3.2 Configuration


This section is described the configuration using the example of ECAT-2055 and the *EtherCAT Configurator* supplied by Beckhoff. Otherwise, if another tool is used, choose a configuration method as applicable.

1. Start your *EtherCAT Configurator*.
2. Choose File, New to create a new I/O Configuration.


3. Click **I/O Device** with the right mouse button and choose **Append Device...** in the menu, and then the dialog window Insert Device is opened.

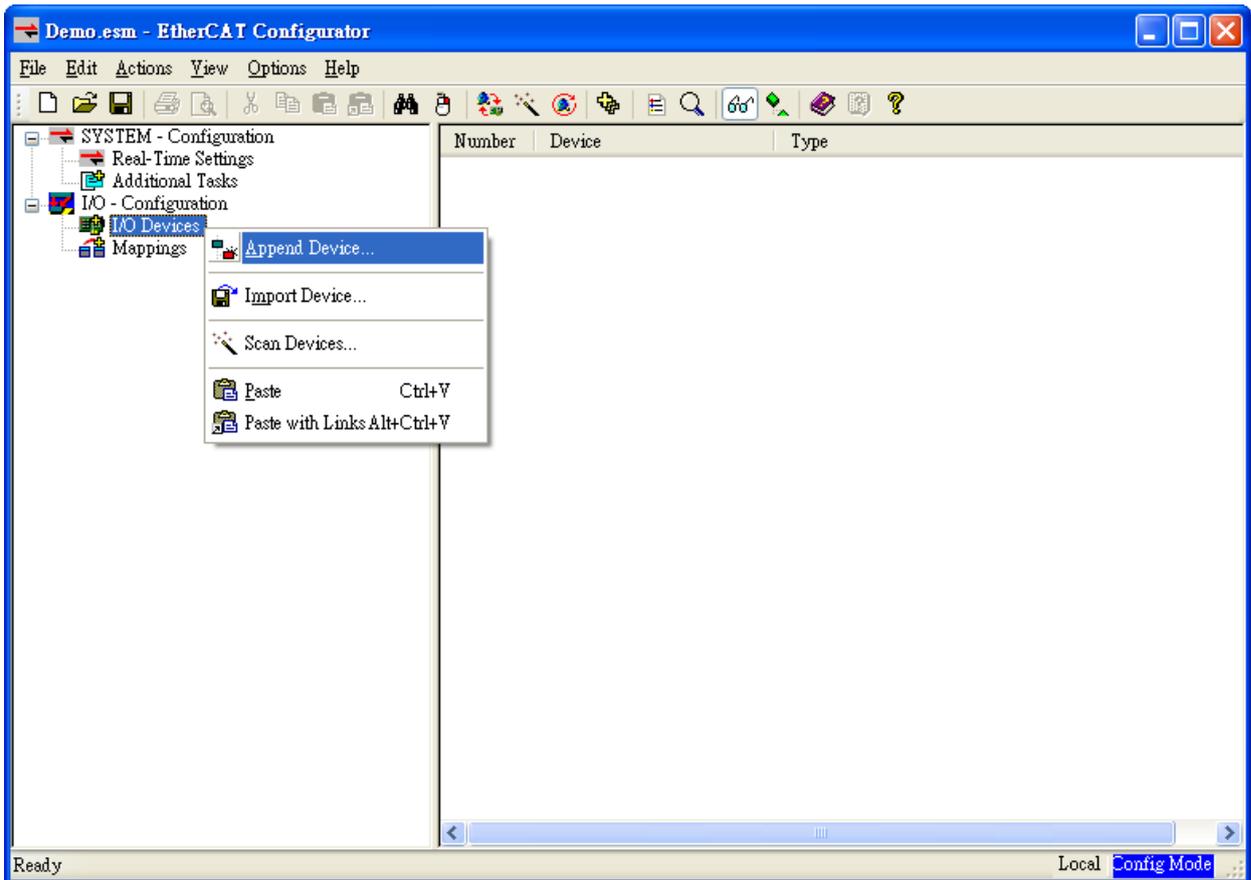


4. Select the **EtherCAT** type in this dialog window and confirm with **OK**.

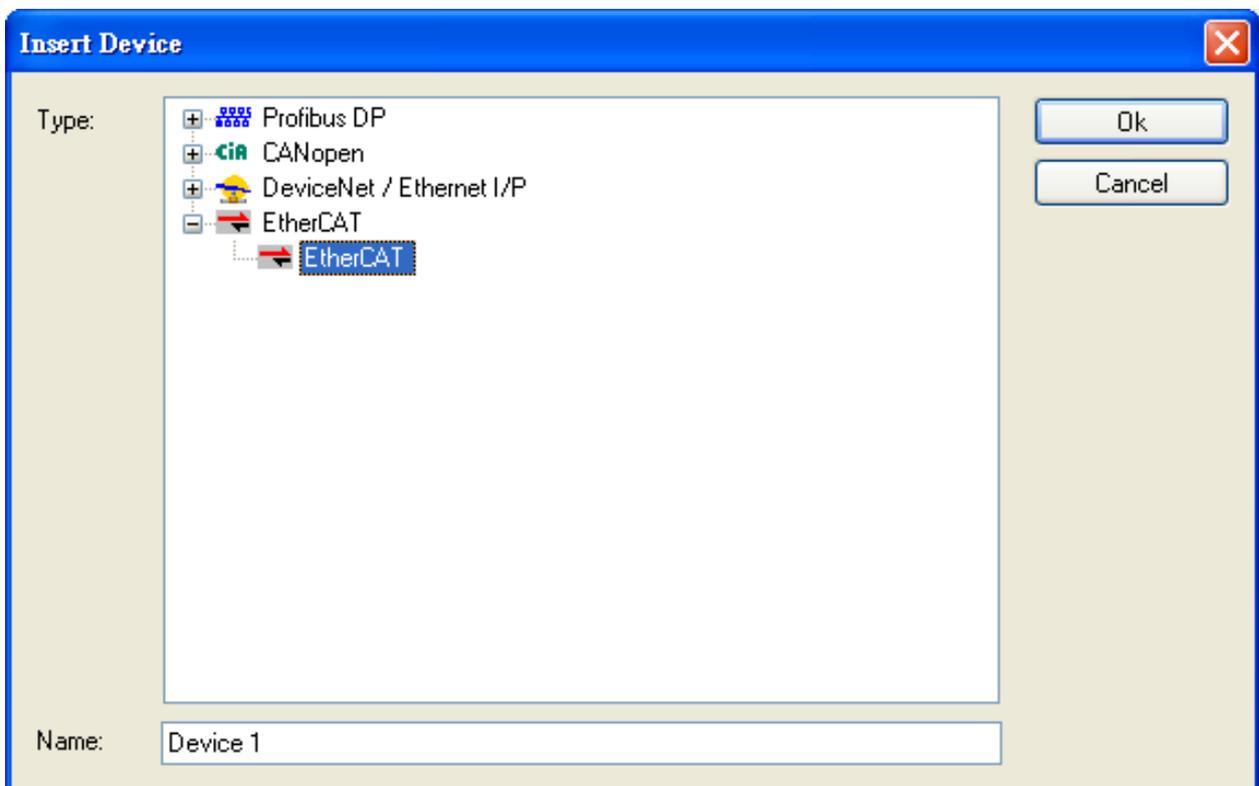


5. **Device 1 (EtherCAT)** is added to to your configuration, i.e. a new EtherCAT line. Click **Device 1(EtherCAT)** with the right mouse button and choose **Scan Boxes...** in the menu.

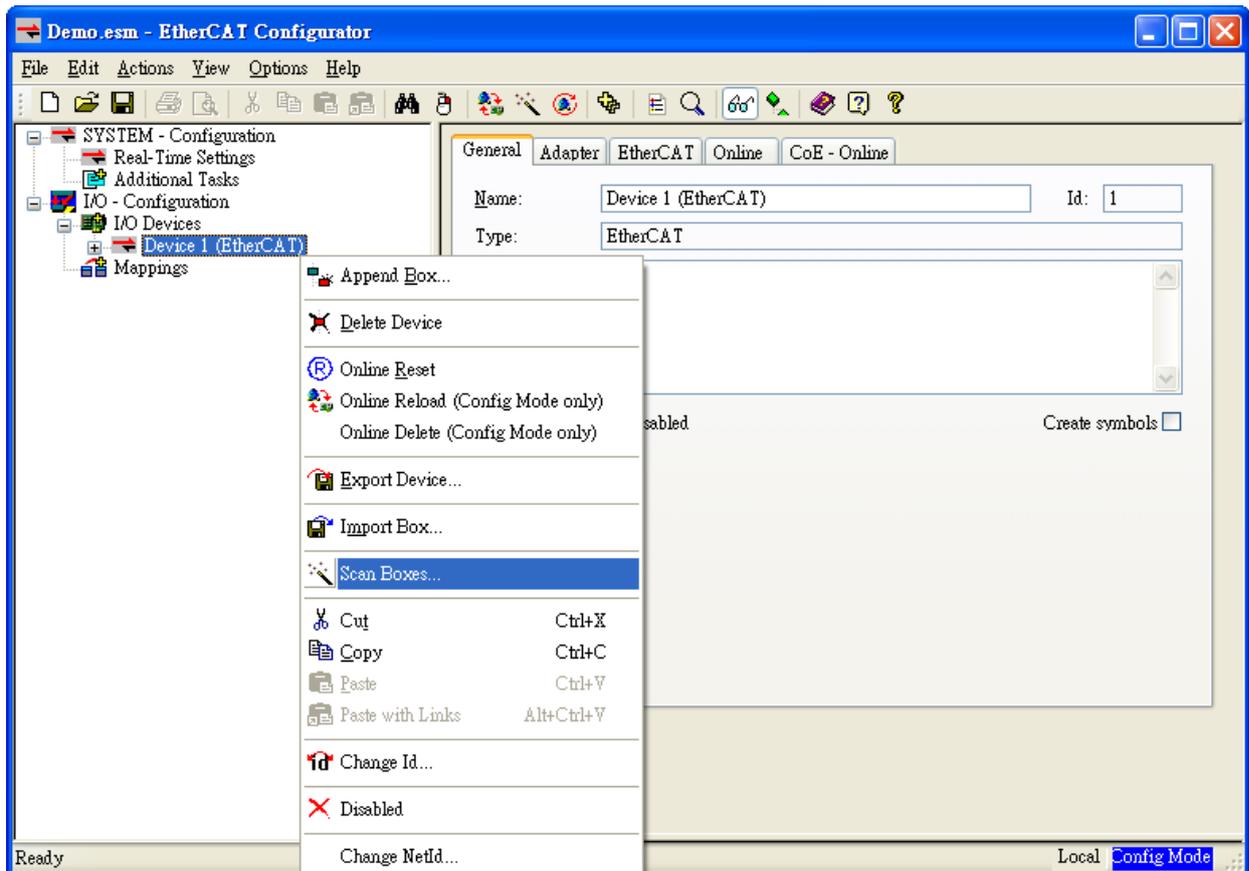

6. Choose the correct network device which is connected to ECAT-2000.

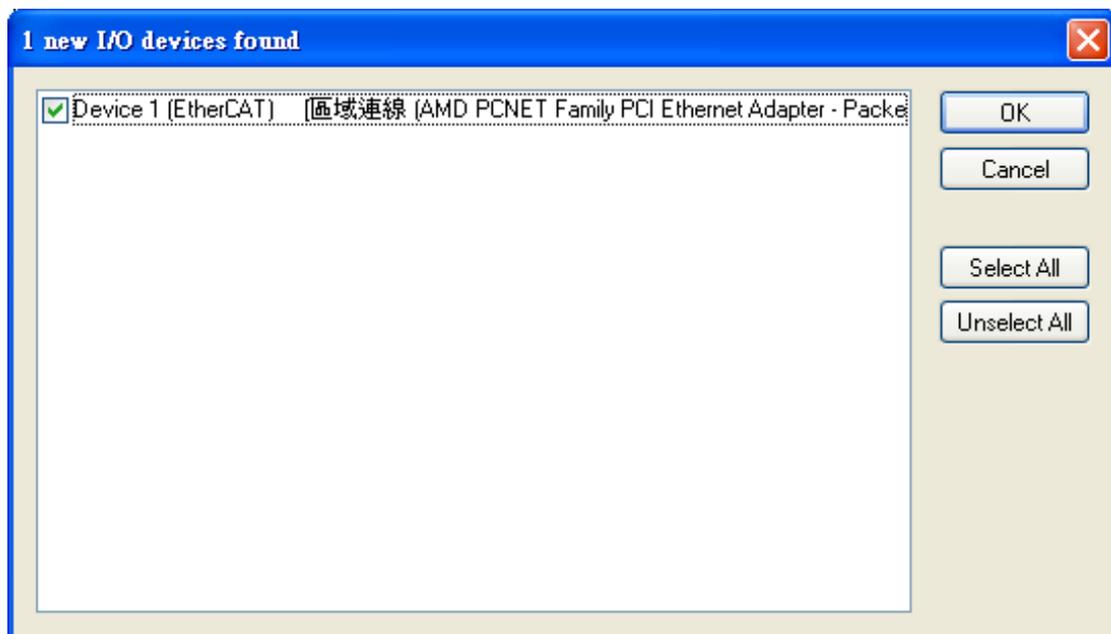

7. If the hint is shown, click **Yes/OK** and continue.

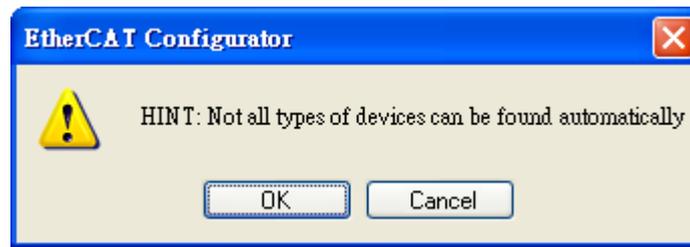


8. Click **Yes** to start scanning for ECAT-2000.




9. Click **Yes** to activate the free run mode for EtherCAT Configurator.



10. The **ECAT-2000 (Box 1)** is now shown in the EtherCAT Configurator.

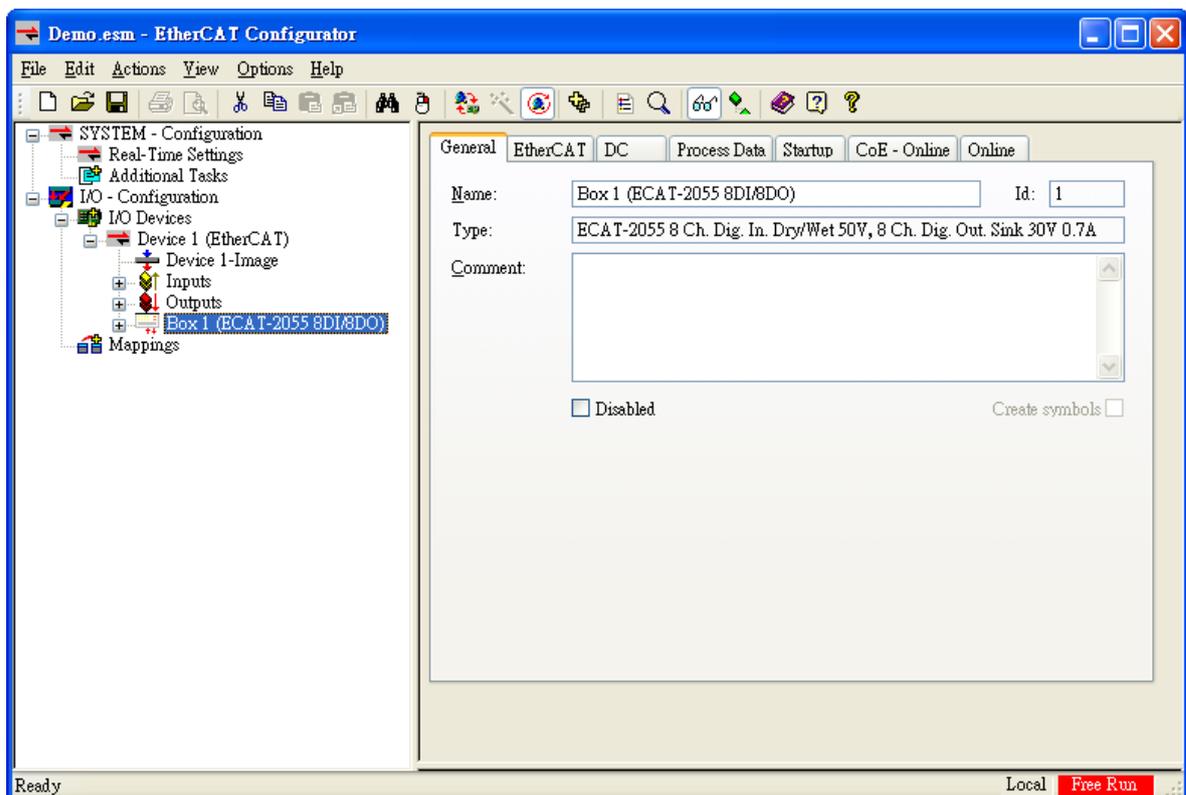

- The input and output variables contained in the ESI (*.xml) file of the ECAT-2000 are displayed as CANopen Process Data Objects(PDO). The PDOs are listed in the *PDO List* of the *Process Data* tab.

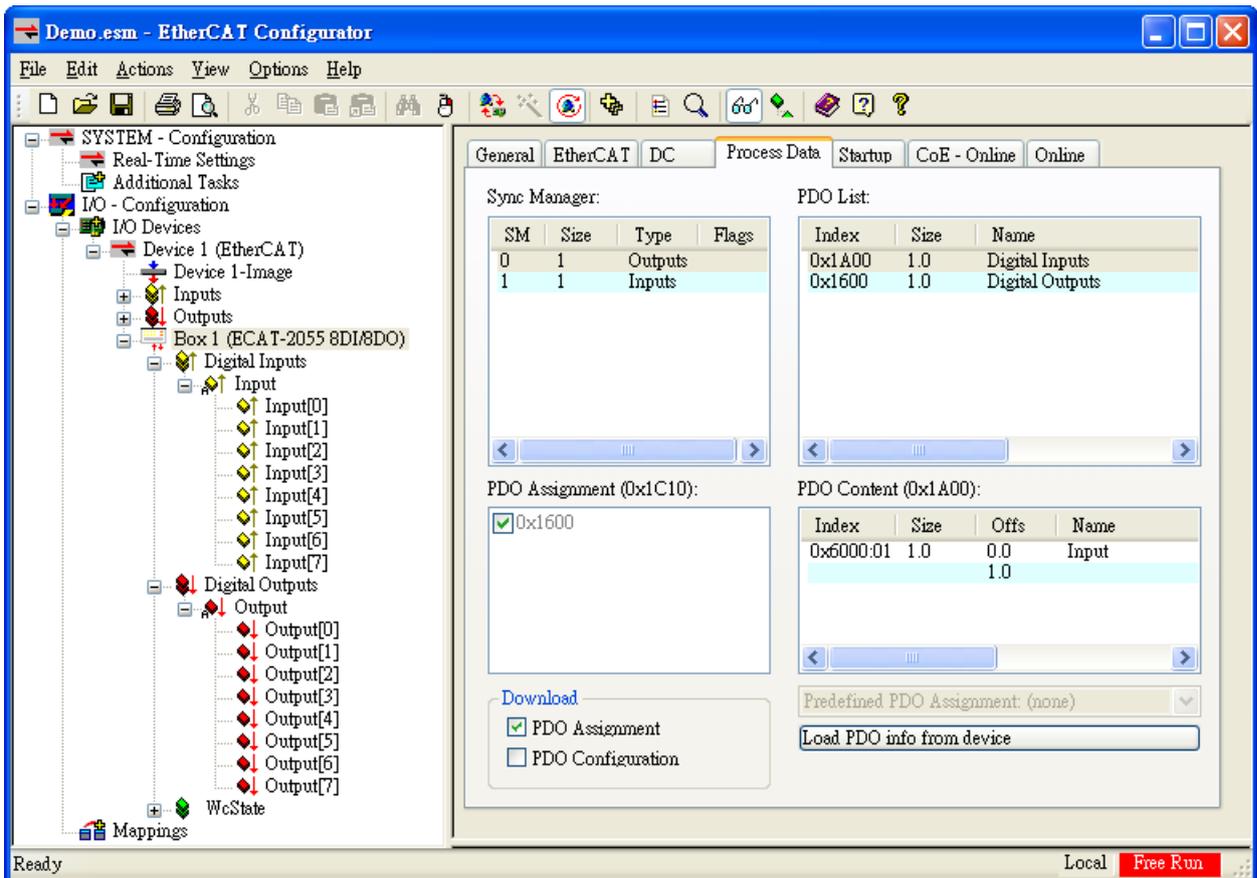

A *Glossary*

A.1 Ordering Information

EtherCAT Slave DIO Modules

| | |
|--------------|--|
| ECAT-2045CR | EtherCAT Slave I/O Module with Isolated 16-ch DO (RoHS) |
| ECAT-2051 CR | EtherCAT Slave I/O Module with Isolated 16-ch DI (RoHS) |
| ECAT-2055 CR | EtherCAT Slave I/O Module with Isolated 8-ch DO and 8-ch DI (RoHS) |
| ECAT-2060 CR | EtherCAT Slave I/O Module with Isolated 6-ch Relay DO and 6-ch DI (RoHS) |

A.2 Technical Support

If you have any difficulties using your ECAT-2000 series modules, please contact us or send a description for the problem to service@icpdas.com.